


- NOTES:
1. DO NOT SCALE DRAWING.
  2. DIMENSIONS ARE IN INCHES [mm].
  3. LHR DOOR SHOWN.
  4. MINIMUM STILE WIDTH: SEE CHART.
  5. SEE DOOR REINFORCEMENTS REQUIRED ON T1000 FOR STEEL DOOR
  6. IF REQUIRED: THRU-BOLT HOLE SIZE  
9/32" INTERIOR DOOR FACE  
3/8" EXTERIOR DOOR FACE.
  7. IF OUTSIDE TRIM IS REQUIRED, REFER TO OUTSIDE TRIM TEMPLATE.

MINIMUM STILE WIDTH	DEVICE TYPE	BACKSET
3-1/2 (90)	STANDARD	2-1/4 (57.2)
2 (50.8)	NSK	1-1/8 (28.6)

NOTE: FOR ALUMINUM DOOR, SEE TEMPLATE T2101  
FOR WOOD DOOR, SEE TEMPLATE T2102

ROD GUARD/COVERS  
(OPTIONAL)  
ADDITIONAL HOLES  
FIELD APPLIED

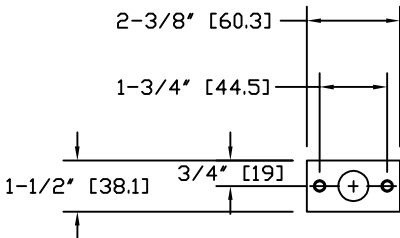

HDG. \_\_\_\_\_ DR. \_\_\_\_\_

**RESPONSIBILITY**  
Door and Frame Manufacturers are responsible for providing adequate construction or reinforcements for proper installation of hardware shown. All architectural builders hardware must be installed on properly reinforced doors and frames regardless of the type, material or method of construction.

TEMPLATE  
METAL DOOR  
V50 & VF50 SERIES  
VERTICAL ROD EXIT DEVICE  
BP-2 MOUNTING PLATE

**DETEX**<sup>®</sup>  
CORPORATION

DO NOT SCALE DRAWING

DATE 4-16-09	TEMPLATE NUMBER T2100
-----------------	--------------------------